

# Gas Tool / Fastener Suitability


Direct Fastening Solutions

<p>Gas Tool G3</p>																																																													
<p>Fuel Cell GFC34</p>																																																													
<p>0.106"-Diameter Shank Pins GDP US Patent 605,016</p>	<table border="1"> <thead> <tr> <th>Model No.</th> <th>Pin Length (in.)</th> </tr> </thead> <tbody> <tr> <td>GDP-50KT</td> <td>1/2</td> </tr> <tr> <td>GDP-62KT</td> <td>5/8</td> </tr> <tr> <td>GDP-75KT</td> <td>3/4</td> </tr> <tr> <td>GDP-100KT</td> <td>1</td> </tr> <tr> <td>GDP-125KT</td> <td>1 1/4</td> </tr> <tr> <td>GDP-150KT</td> <td>1 1/2</td> </tr> </tbody> </table>	Model No.	Pin Length (in.)	GDP-50KT	1/2	GDP-62KT	5/8	GDP-75KT	3/4	GDP-100KT	1	GDP-125KT	1 1/4	GDP-150KT	1 1/2																																														
Model No.	Pin Length (in.)																																																												
GDP-50KT	1/2																																																												
GDP-62KT	5/8																																																												
GDP-75KT	3/4																																																												
GDP-100KT	1																																																												
GDP-125KT	1 1/4																																																												
GDP-150KT	1 1/2																																																												
<p>0.118"- / 0.102"-Diameter Stepped-Shank Pins GDPS</p>	<table border="1"> <thead> <tr> <th>Model No.</th> <th>Pin Length (in.)</th> </tr> </thead> <tbody> <tr> <td>GDPS-50KT</td> <td>1/2</td> </tr> <tr> <td>GDPS-62KT</td> <td>5/8</td> </tr> <tr> <td>GDPS-75KT</td> <td>3/4</td> </tr> </tbody> </table>	Model No.	Pin Length (in.)	GDPS-50KT	1/2	GDPS-62KT	5/8	GDPS-75KT	3/4																																																				
Model No.	Pin Length (in.)																																																												
GDPS-50KT	1/2																																																												
GDPS-62KT	5/8																																																												
GDPS-75KT	3/4																																																												
<p>Spiral Knurl Pins GDPSK</p>	<table border="1"> <thead> <tr> <th>Model No.</th> <th>Pin Length (in.)</th> </tr> </thead> <tbody> <tr> <td>GDPSK-138KT</td> <td>1 3/8</td> </tr> </tbody> </table>	Model No.	Pin Length (in.)	GDPSK-138KT	1 3/8																																																								
Model No.	Pin Length (in.)																																																												
GDPSK-138KT	1 3/8																																																												
<p>Mechanical, Electrical, Plumbing and Ceiling Pins</p>	<table border="1"> <thead> <tr> <th rowspan="2">Model No.</th> <th colspan="2">Pin</th> <th rowspan="2">Description</th> </tr> <tr> <th>Diameter (in.)</th> <th>Length (in.)</th> </tr> </thead> <tbody> <tr> <td>GCC50-R100</td> <td>0.126</td> <td>1</td> <td>1/2" conduit clip (0.047" thick) with pin</td> </tr> <tr> <td>GCC75-R100</td> <td>0.126</td> <td>1</td> <td>3/4" conduit clip (0.059" thick) with pin</td> </tr> <tr> <td>GCC100-R100</td> <td>0.126</td> <td>1</td> <td>1" conduit clip (0.059" thick) with pin</td> </tr> <tr> <td>GCC125-R50</td> <td>0.126</td> <td>1</td> <td>1 1/4" conduit clip (0.071" thick) with pin</td> </tr> <tr> <td>GCL50-R50</td> <td>0.126</td> <td>1</td> <td>1/2" conduit clamp (0.047" thick) with pin</td> </tr> <tr> <td>GCL75-R25</td> <td>0.126</td> <td>1</td> <td>3/4" conduit clamp (0.047" thick) with pin</td> </tr> <tr> <td>GAC-R100</td> <td>0.126</td> <td>1</td> <td>90° ceiling angle clip (0.071" thick) with pin</td> </tr> <tr> <td>GCT-R50</td> <td>0.126</td> <td>1</td> <td>Tie-strap holder (0.0315" thick) with pin</td> </tr> <tr> <td>GW50-R200</td> <td>0.128/0.110</td> <td>1/2</td> <td>1/2" dome washer stepped-shank pin</td> </tr> <tr> <td>GW75-R200</td> <td>0.126</td> <td>3/4</td> <td>1/2" dome washer pin</td> </tr> <tr> <td>GW100-R100</td> <td>0.126</td> <td>1</td> <td>1/2" dome washer pin</td> </tr> <tr> <td>GTS4-5075-R200</td> <td>0.128</td> <td>1 1/4</td> <td>1/4" - 20 threaded stud (3/4" shank and 1/2" thread)</td> </tr> <tr> <td>GTH-R200</td> <td>0.126</td> <td>1</td> <td>Top-Hat pin</td> </tr> </tbody> </table>	Model No.	Pin		Description	Diameter (in.)	Length (in.)	GCC50-R100	0.126	1	1/2" conduit clip (0.047" thick) with pin	GCC75-R100	0.126	1	3/4" conduit clip (0.059" thick) with pin	GCC100-R100	0.126	1	1" conduit clip (0.059" thick) with pin	GCC125-R50	0.126	1	1 1/4" conduit clip (0.071" thick) with pin	GCL50-R50	0.126	1	1/2" conduit clamp (0.047" thick) with pin	GCL75-R25	0.126	1	3/4" conduit clamp (0.047" thick) with pin	GAC-R100	0.126	1	90° ceiling angle clip (0.071" thick) with pin	GCT-R50	0.126	1	Tie-strap holder (0.0315" thick) with pin	GW50-R200	0.128/0.110	1/2	1/2" dome washer stepped-shank pin	GW75-R200	0.126	3/4	1/2" dome washer pin	GW100-R100	0.126	1	1/2" dome washer pin	GTS4-5075-R200	0.128	1 1/4	1/4" - 20 threaded stud (3/4" shank and 1/2" thread)	GTH-R200	0.126	1	Top-Hat pin		
Model No.	Pin		Description																																																										
	Diameter (in.)	Length (in.)																																																											
GCC50-R100	0.126	1	1/2" conduit clip (0.047" thick) with pin																																																										
GCC75-R100	0.126	1	3/4" conduit clip (0.059" thick) with pin																																																										
GCC100-R100	0.126	1	1" conduit clip (0.059" thick) with pin																																																										
GCC125-R50	0.126	1	1 1/4" conduit clip (0.071" thick) with pin																																																										
GCL50-R50	0.126	1	1/2" conduit clamp (0.047" thick) with pin																																																										
GCL75-R25	0.126	1	3/4" conduit clamp (0.047" thick) with pin																																																										
GAC-R100	0.126	1	90° ceiling angle clip (0.071" thick) with pin																																																										
GCT-R50	0.126	1	Tie-strap holder (0.0315" thick) with pin																																																										
GW50-R200	0.128/0.110	1/2	1/2" dome washer stepped-shank pin																																																										
GW75-R200	0.126	3/4	1/2" dome washer pin																																																										
GW100-R100	0.126	1	1/2" dome washer pin																																																										
GTS4-5075-R200	0.128	1 1/4	1/4" - 20 threaded stud (3/4" shank and 1/2" thread)																																																										
GTH-R200	0.126	1	Top-Hat pin																																																										

See product guide (S-A-PG) and [strongtie.com](http://strongtie.com) for additional information.

# Gas- and Powder-Actuated Fasteners Design Information – Concrete

## Powder-Actuated and Gas-Actuated Fasteners – Allowable Tension Loads in Normal-Weight Concrete



Direct Fastening Type	Model No.	Shank Diameter in. (mm)	Minimum Embedment in. (mm)	Minimum Edge Distance in. (mm)	Minimum Spacing in. (mm)	Allowable Tension Load — lb. (kN)				
						f <sub>c</sub> = 2,500 psi (17.2 MPa)	f <sub>c</sub> = 3,000 psi (20.7 MPa)	f <sub>c</sub> = 4,000 psi (27.6 MPa)	f <sub>c</sub> = 5,000 psi (34.5 MPa)	f <sub>c</sub> = 6,000 psi (41.3 MPa)
Powder Actuated	PDPA PDPAT PDPAWL	0.157 (4.0)	3/4 (19)	3 1/2 (89)	5 (127)	110 (0.49)	110 (0.49)	110 (0.49)	—	110 (0.49)
			1 (25)	3 1/2 (89)	5 (127)	210 (0.93)	240 (1.07)	310 (1.38)	—	160 (0.71)
			1 1/4 (32)	3 1/2 (89)	5 (127)	320 (1.42)	340 (1.51)	380 (1.69)	—	365 (1.62)
			1 1/2 (38)	3 1/2 (89)	5 (127)	375 (1.67)	400 (1.78)	450 (2.00)	—	465 (2.07)
	PINW PINWP	0.145 (3.7)	1 (25)	3 (76)	4 (102)	70 (0.31)	100 (0.44)	150 (0.67)	—	150 (0.67)
			1 1/4 (32)	3 (76)	4 (102)	195 (0.87)	255 (1.13)	370 (1.65)	—	370 (1.65)
PSLV3	0.205 (5.2)	1 1/4 (32)	4 (102)	6 (152)	260 (1.16)	—	—	—	—	
Gas Actuated	GDP	0.106 (2.7)	5/8 (16)	3 (76)	4 (102)	25 (0.11)	30 (0.13)	45 (0.20)	45 (0.20)	—
			3/4 (19)	3 (76)	4 (102)	30 (0.13)	30 (0.13)	30 (0.13)	30 (0.13)	—
	GW-75 GW-100 GTH	0.126 (3.2)	5/8 (16)	3 (76)	4 (102)	65 (0.29)	70 (0.31)	95 (0.42)	—	—
			3/4 (19)	3 (76)	4 (102)	95 (0.42)	105 (0.47)	190 (0.85)	—	—

1. The fasteners must not be driven until the concrete has reached the designated minimum compressive strength.
2. Minimum concrete thickness must be three times the fastener embedment into the concrete.
3. The allowable tension values are only for the fastener in the concrete. Members connected to the concrete must be investigated in accordance with accepted design criteria.
4. The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 and ESR-2811 code reports for seismic load conditions.
5. For fastener installation in concrete with compressive strength outside of the listed range, published allowable loads shall not be extrapolated.

## Powder-Actuated and Gas-Actuated Fasteners – Allowable Shear Loads in Normal-Weight Concrete



Direct Fastening Type	Model No.	Shank Diameter in. (mm)	Minimum Embedment in. (mm)	Minimum Edge Distance in. (mm)	Minimum Spacing in. (mm)	Allowable Shear Load — lb. (kN)				
						f <sub>c</sub> = 2,500 psi (17.2 MPa)	f <sub>c</sub> = 3,000 psi (20.7 MPa)	f <sub>c</sub> = 4,000 psi (27.6 MPa)	f <sub>c</sub> = 5,000 psi (34.5 MPa)	f <sub>c</sub> = 6,000 psi (41.3 MPa)
Powder Actuated	PDPA PDPAT PDPAWL	0.157 (4.0)	3/4 (19)	3 1/2 (89)	5 (127)	120 (0.53)	125 (0.56)	135 (0.60)	—	130 (0.58)
			1 (25)	3 1/2 (89)	5 (127)	285 (1.27)	290 (1.29)	310 (1.38)	—	350 (1.56)
			1 1/4 (32)	3 1/2 (89)	5 (127)	360 (1.60)	380 (1.69)	420 (1.87)	—	390 (1.73)
			1 1/2 (38)	3 1/2 (89)	5 (127)	405 (1.80)	430 (1.91)	485 (2.16)	—	495 (2.20)
	PINW PINWP	0.145 (3.7)	1 (25)	3 (76)	4 (102)	140 (0.62)	165 (0.73)	205 (0.91)	—	205 (0.91)
			1 1/4 (32)	3 (76)	4 (102)	265 (1.18)	265 (1.18)	265 (1.18)	—	265 (1.18)
Gas Actuated	GDP	0.106 (2.7)	5/8 (16)	3 (76)	4 (102)	25 (0.11)	25 (0.11)	25 (0.11)	25 (0.11)	—
			3/4 (19)	3 (76)	4 (102)	50 (0.22)	55 (0.24)	75 (0.33)	75 (0.33)	—
	GW-75 GW-100 GTH	0.126 (3.2)	5/8 (16)	3 (76)	4 (102)	60 (0.27)	65 (0.29)	95 (0.42)	—	—
			3/4 (19)	3 (76)	4 (102)	135 (0.60)	145 (0.64)	215 (0.96)	—	—

1. The fasteners must not be driven until the concrete has reached the designated minimum compressive strength.
2. Minimum concrete thickness must be three times the fastener embedment into the concrete.
3. The allowable shear values are only for the fastener in the concrete. Members connected to the concrete must be investigated in accordance with accepted design criteria.
4. The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 and ESR-2811 code reports for seismic load conditions.
5. For fastener installation in concrete with compressive strength outside of the listed range, published allowable loads shall not be extrapolated.

\*See p. 14 for an explanation of the load table icons.

# Gas- and Powder-Actuated Fasteners Design Information – Concrete

## Powder-Actuated and Gas-Actuated Assemblies — Allowable Tension Loads in Normal-Weight Concrete



Direct Fastening Type	Model No.	Shank Diameter in. (mm)	Minimum Embedment in. (mm)	Minimum Edge Distance in. (mm)	Minimum Spacing in. (mm)	Allowable Tension Load — lb. (kN)				
						f <sub>c</sub> = 2,500 psi (17.2 MPa)	f <sub>c</sub> = 3,000 psi (20.7 MPa)	f <sub>c</sub> = 4,000 psi (27.6 MPa)	f <sub>c</sub> = 5,000 psi (34.5 MPa)	f <sub>c</sub> = 6,000 psi (41.3 MPa)
Powder Actuated	PCLDPA	0.157 (4.0)	¾ (19)	3½ (89)	5 (102)	70 (0.31)	—	120 (0.53)	—	130 (0.58)
			1 (25)	3½ (89)	5 (102)	175 (0.78)	—	180 (0.80)	—	190 (0.85)
			1¼ (32)	3½ (89)	5 (102)	210 (0.93)	—	210 (0.93)	—	190 (0.85)
	PECLDPA	0.157 (4.0)	7/8 (22)	3½ (89)	5 (102)	90 (0.40)	—	110 (0.49)	—	85 (0.38)
			1 (25)	3½ (89)	5 (102)	180 (0.80)	—	155 (0.69)	—	180 (0.80)
	PTRHA3 PTRHA4	0.157 (4.0)	1¼ (32)	3½ (89)	5 (102)	185 (0.82)	—	220 (0.98)	—	190 (0.85)
Gas Actuated	GAC	0.126 (3.2)	¾ (19)	3 (76)	4 (102)	105 (0.47)	120 (0.53)	150 (0.67)	170 (0.76)	195 (0.87)

- The fasteners must not be driven until the concrete has reached the designated minimum compressive strength.
- Minimum concrete thickness must be three times the fastener embedment into the concrete.
- The allowable tension values are only for the fastener in the concrete. Members connected to the concrete must be investigated in accordance with accepted design criteria.
- The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 and ESR-2811 code reports for seismic load conditions.
- For fastener installation in concrete with compressive strength outside of the listed range, published allowable loads shall not be extrapolated.

## Powder-Actuated and Gas-Actuated Assemblies — Allowable Oblique Loads in Normal-Weight Concrete



Direct Fastening Type	Model No.	Shank Diameter in. (mm)	Minimum Embedment in. (mm)	Minimum Edge Distance in. (mm)	Minimum Spacing in. (mm)	Allowable Oblique Load — lb. (kN)				
						f <sub>c</sub> = 2,500 psi (17.2 MPa)	f <sub>c</sub> = 3,000 psi (20.7 MPa)	f <sub>c</sub> = 4,000 psi (27.6 MPa)	f <sub>c</sub> = 5,000 psi (34.5 MPa)	f <sub>c</sub> = 6,000 psi (41.3 MPa)
Powder Actuated	PCLDPA	0.157 (4.0)	¾ (19)	3½ (89)	5 (102)	115 (0.51)	—	105 (0.47)	—	140 (0.62)
			1 (25)	3½ (89)	5 (102)	255 (1.13)	—	240 (1.07)	—	245 (1.09)
			1¼ (32)	3½ (89)	5 (102)	250 (1.11)	—	265 (1.18)	—	265 (1.18)
	PECLDPA	0.157 (4.0)	7/8 (22)	3½ (89)	5 (102)	135 (0.60)	—	130 (0.58)	—	115 (0.51)
			1 (25)	3½ (89)	5 (102)	225 (1.00)	—	230 (1.02)	—	255 (1.13)
	Gas Actuated	GAC	0.126 (3.2)	¾ (19)	3 (76)	4 (102)	130 (0.58)	135 (0.60)	145 (0.64)	155 (0.69)

- The fasteners must not be driven until the concrete has reached the designated minimum compressive strength.
- Minimum concrete thickness must be three times the fastener embedment into the concrete.
- The allowable oblique values are only for the fastener in the concrete. Members connected to the concrete must be investigated in accordance with accepted design criteria.
- Oblique load direction is 45° from the concrete member surface.
- The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 and ESR-2811 code reports for seismic load conditions.
- For fastener installation in concrete with compressive strength outside of the listed range, published allowable loads shall not be extrapolated.

## Gas- and Powder-Actuated Fasteners Design Information – Concrete

Powder-Actuated Fasteners — Allowable Tension and Shear Loads  
for Attachment of Wood Sill Plates to Normal-Weight Concrete

Direct Fastening Type	Model No.	Shank Length in. (mm)	Nominal Head Diameter in. (mm)	Shank Diameter in. (mm)	Washer Thickness in. (mm)	Washer Bearing Area in. <sup>2</sup> (mm <sup>2</sup> )	f' <sub>c</sub> = 2,500 psi (17.2 MPa)	
							Allowable Tension Load lb. (kN)	Allowable Shear Load lb. (kN)
Powder Actuated	PDPAWL-287 PDPAWL-287MG	2 <sup>7</sup> / <sub>8</sub> (73)	0.300 (7.6)	0.157 (4.0)	0.070 (1.8)	0.767 (495)	200 (0.89)	205 (0.91)

1. The fasteners must not be driven until the concrete has reached the designated minimum compressive strength.
2. Minimum concrete thickness must be three times the fastener embedment into the concrete.
3. The allowable tension and shear values are only for the fastener in the concrete. Members connected to the concrete must be investigated in accordance with accepted design criteria.
4. Minimum concrete edge distance is 1<sup>3</sup>/<sub>4</sub>" (44.5 mm).
5. Only mechanically galvanized fasteners (with 'MG' in the designation) may be used to attach preservative-treated wood to concrete.
6. Minimum spacing shall be 4" (101.6 mm) on center.
7. The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 code report for seismic load conditions.

Pin Spacing Requirements of Powder-Actuated Fasteners for Attachment  
of Wood Sill Plates for Interior Non-Structural Walls to Normal-Weight Concrete

Direct Fastening Type	Model No.	Shank Length in. (mm)	Shank Diameter in. (mm)	Concrete Edge Distance in. (mm)	Maximum Spacing in. (mm)
Powder Actuated	PDPAWL-287 <sup>3</sup> PDPAWL-287MG <sup>3</sup>	2 <sup>7</sup> / <sub>8</sub> (73)	0.157 (4.0)	1 <sup>3</sup> / <sub>4</sub> (44.5)	48 (1,219)

1. Spacings are based upon the attachment of 2" (nominal thickness) wood sill plates, with specific gravity of 0.50 or greater, to concrete floor slabs or footings.
2. All walls shall have fasteners placed at 6" (152.4 mm) from ends of sill plates, with maximum spacing as shown in the table.
3. Fasteners shall not be driven until the concrete has reached a compressive strength of 2,500 psi.
4. The maximum horizontal transverse load on the wall shall be 5 psf (0.239 kPa).
5. The maximum wall height shall be 14 feet (4.3 m).
6. For exterior walls and interior structural walls, this table is not applicable and allowable loads must be used.
7. Walls shall be laterally supported at the top and the bottom.
8. Minimum fastener spacing shall be 4" (101.6 mm) on center.
9. Only mechanically galvanized fasteners (with 'MG' in the designation) may be used to attach preservative-treated wood to concrete.

# Gas- and Powder-Actuated Fasteners Design Information – Concrete

Powder-Actuated and Gas-Actuated Fasteners – Allowable Tension Loads in Sand-Lightweight Concrete over Steel Deck



Direct Fastening Solutions

Direct Fastening Type	Model No.	Shank Diameter in. (mm)	Minimum Embedment in. (mm)	Allowable Tension Load — lb. (kN)				
				$f'_c = 3,000$ psi (20.7 MPa) Sand-Light Weight Concrete				
				Installed in Top Side of Concrete <sup>4</sup>	Installed Through 3" "W" Deck with		Installed Through 1.5" "B" Deck with	
					3 1/4" Concrete Fill <sup>5</sup>	2 1/4" Concrete Fill <sup>6</sup>	2 1/4" Concrete Fill <sup>7</sup>	2" Concrete Fill <sup>8</sup>
Figure 1, 2 and 3	Figure 1	Figure 1	Figure 2 and 3	Figure 2				
Powder Actuated	PDDPA PDDPAT PDDPAWL	0.157 (4.0)	3/4 (19)	85 (0.38)	105 (0.47)	—	—	160 (0.71)
			1 (25)	150 (0.67)	145 (0.64)	—	—	210 (0.93)
			1 1/4 (32)	320 (1.42)	170 (0.76)	—	—	265 (1.18)
			1 1/2 (38)	385 (1.71)	325 (1.45)	—	—	—
	PINW PINWP	0.145 (3.7)	7/8 (22)	85 (0.38)	40 (0.18)	—	—	—
PSLV3	0.205 (5.2)	1 1/4 (32)	—	225 (1.00)	—	—	—	
Gas Actuated	GDP	0.106 (2.7)	5/8 (16)	75 (0.33)	—	60 (0.27)	65 (0.29)	—
			3/4 (19)	105 (0.47)	—	60 (0.27)	130 (0.58)	—
	GW-75 GW-100 GTH	0.126 (3.2)	5/8 (16)	60 (0.27)	—	35 (0.16)	—	—
			3/4 (19)	115 (0.51)	—	55 (0.24)	—	—

- The fastener shall not be driven until the concrete has reached the designated compressive strength.
- The allowable tension values are for the fastener only. Members connected to the concrete must be investigated separately in accordance with accepted design criteria.
- Steel deck must be minimum 20 gauge and have a minimum yield strength of 38,000 psi.
- The minimum fastener spacing is 4". The minimum edge distances are 3 1/2" and 3" for powder-actuated fasteners and gas-actuated fasteners, respectively.
- The fastener shall be installed minimum 1 1/2" from the edge of flute and 4" from the end of the deck. The minimum fastener spacing is 4".
- The fastener shall be installed minimum 1" from the edge of flute and 3" from the end of the deck. The minimum fastener spacing is 4". For GW and GTH fasteners, the fastener must be a minimum of 1 1/8" from the edge of flute.
- The fastener shall be installed minimum 7/8" from the edge of flute. For inverted 1.5" "B" deck configuration, the fastener must be a minimum of 1" from the edge of flute. Fastener must be installed minimum 3" from the end of the deck. The minimum fastener spacing is 4".
- The fastener shall be installed minimum 7/8" from the edge of flute and 4" from the end of the deck. The minimum fastener spacing is 4".
- The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 and ESR-2811 code reports for seismic load conditions.
- See figures on the right for nominal deck dimensions and fastener locations.

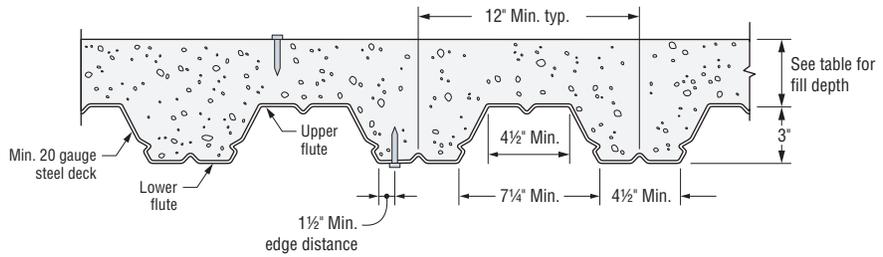


Figure 1. 3" "W" Deck with Concrete Infill

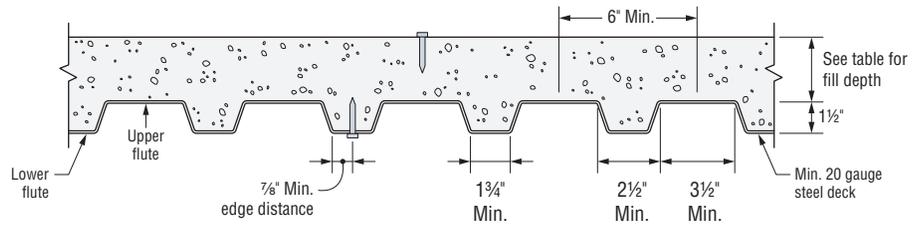


Figure 2. 1 1/2" "B" Deck with Concrete Infill

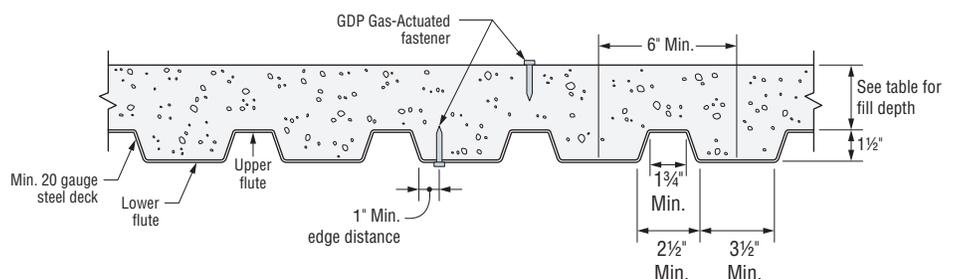


Figure 3. 1 1/2" Inverted "B" Deck with 2 1/4" Concrete Infill

\*See p. 14 for an explanation of the load table icons.

# Gas- and Powder-Actuated Fasteners Design Information – Concrete

Powder-Actuated and Gas-Actuated Fasteners —  
Allowable Shear Loads in Sand-Lightweight Concrete over Steel Deck



Direct Fastening Type	Model No.	Shank Diameter in. (mm)	Minimum Embedment in. (mm)	Allowable Shear Load — lb. (kN)				
				f <sub>c</sub> = 3,000 psi (20.7 MPa) Sand-Light Weight Concrete				
				Installed in Top Side of Concrete <sup>9</sup>	Installed Through 3" "W" Deck with		Installed Through 1.5" "B" Deck with	
					3 1/4" Concrete Fill <sup>5</sup>	2 1/4" Concrete Fill <sup>6</sup>	2 1/4" Concrete Fill <sup>7</sup>	2" Concrete Fill <sup>8</sup>
Figure 1, 2 and 3 <sup>11</sup>	Figure 1 <sup>11</sup>	Figure 1 <sup>11</sup>	Figure 2 and 3 <sup>11</sup>	Figure 2 <sup>11</sup>				
Powder Actuated	PDDA PDPAT PDPAWL	0.157 (4.0)	3/4 (19)	105 (0.47)	280 (1.25)	—	—	275 (1.22)
			1 (25)	225 (1.00)	280 (1.25)	—	—	370 (1.65)
			1 1/4 (32)	420 (1.87)	320 (1.42)	—	—	460 (2.05)
			1 1/2 (38)	455 (2.02)	520 (2.31)	—	—	—
PINW PINWP	0.145 (3.7)	7/8 (22)	250 (1.11)	275 (1.22)	—	—	—	
			—	—	—	—	—	
Gas Actuated	GDP	0.106 (2.7)	5/8 (16)	35 (0.16)	—	180 (0.80)	195 (0.87)	—
			3/4 (19)	140 (0.62)	—	180 (0.80)	270 (1.20)	—
	GW-75 GW-100 GTH	0.126 (3.2)	5/8 (16)	110 (0.49)	—	215 (0.96)	—	—
				3/4 (19)	130 (0.58)	—	235 (1.05)	—

1. The fastener shall not be driven until the concrete has reached the designated compressive strength.
2. The allowable shear values are for the fastener only. Members connected to the concrete must be investigated separately in accordance with accepted design criteria.
3. Steel deck must be minimum 20 gauge and have a minimum yield strength of 38,000 psi.
4. Shear values are for loads applied toward edge of flute.
5. The fastener shall be installed minimum 1 1/2" from the edge of flute and 4" from the end of the deck. The minimum fastener spacing is 4".
6. The fastener shall be installed minimum 1" from the edge of flute and 3" from the end of the deck. The minimum fastener spacing is 4". For GW and GTH fasteners, the fastener must be a minimum of 1 1/8" from the edge of flute.
7. The fastener shall be installed minimum 7/8" from the edge of flute. For inverted 1.5" "B" deck configuration, the fastener must be a minimum of 1" from the edge of flute. Fastener must be installed minimum 3" from the end of the deck. The minimum fastener spacing is 4".
8. The fastener shall be installed minimum 7/8" from the edge of flute and 4" from the end of the deck. The minimum fastener spacing is 4".
9. The minimum fastener spacing is 4". The minimum edge distances are 3 1/2" and 3" for powder-actuated fasteners and gas-actuated fasteners, respectively.
10. The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 and ESR-2811 code reports for seismic load conditions.
11. See figures on p. 178 for nominal deck dimensions and fastener locations.

C-A-2023 © 2023 SIMPSON STRONG-TIE COMPANY, INC.

Direct Fastening Solutions

\*See p. 14 for an explanation of the load table icons.

# Gas- and Powder-Actuated Fasteners Design Information – Concrete

## Powder-Actuated and Gas-Actuated Assemblies – Allowable Tension Loads in Sand-Lightweight Concrete over Steel Deck



Direct Fastening Type	Model No.	Shank Diameter in. (mm)	Minimum Embedment in. (mm)	Allowable Tension Load — lb. (kN)			
				$f'_c = 3,000$ psi (20.7 MPa) Sand-Lightweight Concrete			
				Installed Through 3" "W" Deck with		Installed Through 1.5" "B" Deck with	
				2½" Concrete Fill <sup>4</sup>	2¼" Concrete Fill <sup>5</sup>	2¼" Concrete Fill <sup>6</sup>	2" Concrete Fill <sup>7</sup>
Figure 1 <sup>9</sup>		Figure 2 and 3 <sup>9</sup>		Figure 2 <sup>9</sup>			
Powder Actuated	PTRHA3 PTRHA4	0.157 (4.0)	1¼ (32)	160 (0.71)	—	—	175 (0.78)
	PCLDPA	0.157 (4.0)	¾ (19)	115 (0.51)	—	—	60 (0.27)
			1 (25)	140 (0.62)	—	—	160 (0.71)
			1¼ (32)	160 (0.71)	—	—	180 (0.80)
	PECDLPA	0.157 (4.0)	⅞ (22)	80 (0.36)	—	—	95 (0.40)
			1 (25)	120 (0.53)	—	—	135 (0.60)
Gas Actuated	GAC	0.126 (3.2)	¾ (19)	—	105 (0.47)	90 (0.40)	—

- The fastener shall not be driven until the concrete has reached the designated compressive strength.
- The allowable tension values are for the fastener only. Members connected to the concrete must be investigated separately in accordance with accepted design criteria.
- Steel deck must be minimum 20 gauge and have a minimum yield strength of 38,000 psi.
- The fastener shall be installed minimum 1½" from the edge of flute and 4" from the end of the deck. The minimum fastener spacing is 4".
- The fastener shall be installed minimum 1" from the edge of flute and 3" from the end of the deck. The minimum fastener spacing is 4".
- The fastener shall be installed minimum ⅞" from the edge of flute and 3" from the end of the deck. The minimum fastener spacing is 4".
- The fastener shall be installed minimum ⅞" from the edge of flute and 4" from the end of the deck. The minimum fastener spacing is 4".
- The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 and ESR-2811 code reports for seismic load conditions.
- See figures on p. 178 for nominal deck dimensions and fastener locations.

## Powder-Actuated and Gas-Actuated Assemblies – Allowable Oblique Loads in Sand-Lightweight Concrete over Steel Deck




Direct Fastening Type	Model No.	Shank Diameter in. (mm)	Minimum Embedment in. (mm)	Allowable Oblique Load — lb. (kN)			
				$f'_c = 3,000$ psi (20.7 MPa) Sand-Lightweight Concrete			
				Installed Through 3" "W" Deck with		Installed Through 1.5" "B" Deck with	
				2½" Concrete Fill <sup>4</sup>	2¼" Concrete Fill <sup>5</sup>	2¼" Concrete Fill <sup>6</sup>	2" Concrete Fill <sup>7</sup>
Figure 1 <sup>10</sup>		Figure 2 and 3 <sup>10</sup>		Figure 2 <sup>10</sup>			
Powder Actuated	PCLDPA	0.157 (4.0)	¾ (19)	155 (0.69)	—	—	175 (0.78)
			1 (25)	175 (0.78)	—	—	240 (1.07)
			1¼ (32)	185 (0.82)	—	—	280 (1.25)
	PECDLPA	0.157 (4.0)	⅞ (22)	110 (0.49)	—	—	110 (0.49)
			1 (25)	145 (0.64)	—	—	175 (0.78)
Gas Actuated	GAC	0.126 (3.2)	¾ (19)	—	120 (0.53)	90 (0.40)	—

- The fastener shall not be driven until the concrete has reached the designated compressive strength.
- The allowable oblique values are for the fastener only. Members connected to the concrete must be investigated separately in accordance with accepted design criteria.
- Steel deck must be minimum 20 gauge and have a minimum yield strength of 38,000 psi.
- The fastener shall be installed minimum 1½" from the edge of flute and 4" from the end of the deck. The minimum fastener spacing is 4".
- The fastener shall be installed minimum 1" from the edge of flute and 3" from the end of the deck. The minimum fastener spacing is 4".
- The fastener shall be installed minimum ⅞" from the edge of flute and 3" from the end of the deck. The minimum fastener spacing is 4".
- The fastener shall be installed minimum ⅞" from the edge of flute and 4" from the end of the deck. The minimum fastener spacing is 4".
- Oblique load direction is 45° from the concrete member surface.
- The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 and ESR-2811 code reports for seismic load conditions.
- See figures on p. 178 for nominal deck dimensions and fastener locations.

\*See p. 14 for an explanation of the load table icons.

# Gas- and Powder-Actuated Fasteners Design Information – CMU

Powder-Actuated and Gas-Actuated Fasteners – Allowable Tension and Shear Loads in Hollow and Grout-Filled CMU<sup>4,5,8</sup>



Direct Fastening Type	Model No.	Shank Diameter in. (mm)	Minimum Embedment in. (mm)	Minimum Edge Distance in. (mm)	8-inch Hollow CMU		8-inch Grout-Filled CMU	
					Allowable Tension Load lb. (kN)	Allowable Shear Load lb. (kN)	Allowable Tension Load lb. (kN)	Allowable Shear Load lb. (kN)
Powder Actuated	PDPA PDPAT PDPAWL	0.157 (4.0)	1¾ (44)	3½ (89)	125 <sup>1</sup> (0.56)	210 <sup>1</sup> (0.93)	190 <sup>3</sup> (0.85)	245 <sup>3</sup> (1.09)
	PINW PINWP	0.145 (3.7)	1¾ (44)	3½ (89)	110 <sup>1</sup> (0.49)	200 <sup>1</sup> (0.89)	—	—
Gas Actuated	GDP	0.106 (2.7)	⅝ (16)	3 (76)	35 <sup>1</sup> (0.16)	60 <sup>1</sup> (0.27)	—	—
	GW-75 GW-100 GTH	0.126 (3.2)	⅝ (16)	3 (76)	75 <sup>2</sup> (0.33)	90 <sup>2</sup> (0.40)	—	—

1. Allowable values for fasteners in hollow lightweight concrete masonry units conforming to ASTM C90.
2. Allowable values for fasteners in hollow medium-weight concrete masonry units conforming to ASTM C90.
3. Allowable values for fasteners in grout-filled lightweight concrete masonry units conforming to ASTM C90 with coarse grout conforming to ASTM C746.
4. The minimum allowable nominal size of the CMU must be 8" high by 8" wide by 16" long, with a minimum 1¼"-thick face shell thickness.
5. Allowable values are for fasteners installed in the center of a CMU face shell. See Figure 1 for the applicable placement zone.
6. Minimum embedment is measured from the outside face of the CMU.
7. Allowable values are for the fastener only. Members connected to the CMU must be investigated separately in accordance with accepted design criteria.
8. The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 and ESR-2811 code reports for seismic load conditions.

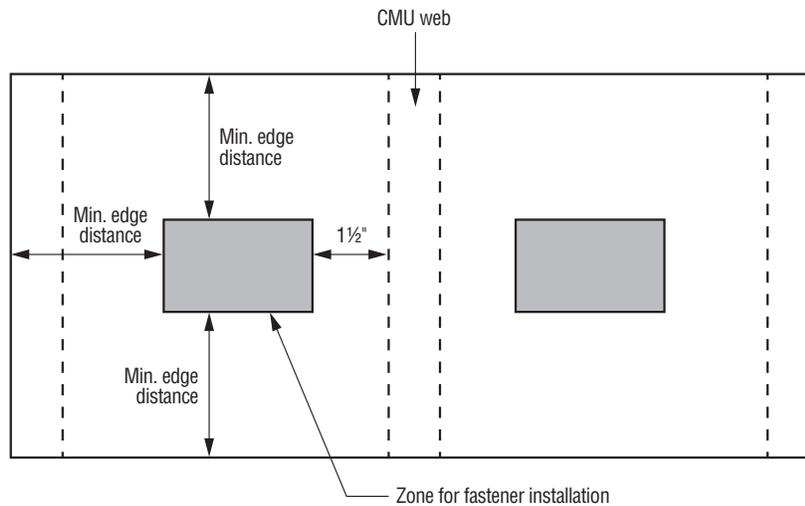


Figure 1. Zone for Fastener Installation in Face Shell of CMU

\*See p. 14 for an explanation of the load table icons.

# Gas- and Powder-Actuated Fasteners Design Information – Steel

Powder-Actuated and Gas-Actuated Fasteners —  
Allowable Tension Loads in Steel<sup>1</sup>



Direct Fastening Type	Model No.	Shank Diameter <sup>10</sup> in. (mm)	Minimum Edge Distance in. (mm)	Minimum Spacing in. (mm)	Minimum Steel Strength <sup>3</sup> ASTM	Allowable Tension Load — lb. (kN)					
						Steel Thickness					
						1/8"	3/16"	1/4"	3/8"	1/2"	3/4"
Powder Actuated	PDP PDPAT PDPRAWL	0.157 (4.0)	1/2 (13)	1 (25)	A36	—	260 (1.16)	370 (1.65)	380 <sup>7</sup> (1.69)	530 <sup>7</sup> (2.36)	195 <sup>4</sup> (0.87)
			1/2 (13)	1 (25)	A572 Gr. 50 or A992	—	305 (1.36)	335 (1.49)	355 <sup>7</sup> (1.58)	485 <sup>5</sup> (2.16)	170 <sup>6</sup> (0.76)
	PINW PINWP	0.145 (3.7)	1/2 (13)	1 (25)	A36	—	155 (0.69)	—	—	—	—
	PSLV3 Smooth shank	0.205 (5.2)	1 (25)	1 1/2 (38)	A36	—	270 (1.20)	680 (3.02)	—	—	—
	PSLV3-12575K Knurled shank	0.205 (5.2)	1 (25)	1 1/2 (38)	A36	—	270 (1.20)	870 (3.87)	—	—	—
Gas Actuated	GDP	0.106 (2.7)	1/2 (13)	1 (25)	A36	125 (0.56)	210 (0.93)	220 (0.98)	—	—	—
			1/2 (13)	1 (25)	A572 Gr. 50 or A992	—	225 (1.00)	185 (0.82)	—	—	—
	GDPS	0.118/0.102 (3.0/2.6)	1/2 (13)	1 (25)	A36	—	95 (0.42)	170 (0.76)	165 <sup>8</sup> (0.73)	145 <sup>8</sup> (0.64)	—
			1/2 (13)	1 (25)	A572 Gr. 50 or A992	—	110 (0.49)	170 (0.76)	155 <sup>8</sup> (0.69)	—	—
	GW-50	0.128/0.110 (3.3/2.8)	1/2 (13)	1 (25)	A36	—	225 (1.00)	275 (1.22)	245 <sup>9</sup> (1.09)	—	—
			1/2 (13)	1 (25)	A572 Gr. 50 or A992	—	240 (1.07)	215 <sup>9</sup> (0.96)	280 <sup>9</sup> (1.25)	—	—

- The entire pointed portion of the fastener must penetrate through the steel to obtain the tabulated values, unless otherwise indicated.
- The allowable tension values are for the fastener only. Members connected to the steel must be investigated separately in accordance with accepted design criteria.
- Steel strength must comply with the minimum requirements of ASTM A 36 ( $F_y = 36$  ksi,  $F_u = 58$  ksi), ASTM A 572, Grade 50 ( $F_y = 50$  ksi,  $F_u = 65$  ksi), or ASTM A992 ( $F_y = 50$  ksi,  $F_u = 65$  ksi).
- Based upon minimum penetration depth of 0.46" (11.7 mm).
- Based upon minimum penetration depth of 0.58" (14.7 mm).
- Based upon minimum penetration depth of 0.36" (9.1 mm).
- The fastener must be driven to where the point of the fastener penetrates through the steel.
- Based upon minimum penetration depth of 0.35" (8.9 mm).
- Based upon minimum penetration depth of 0.25" (6.4 mm).
- For stepped shank fasteners: (Diameter of shank above the step)/(Diameter of shank below the step)
- The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 and ESR-2811 code reports for seismic load conditions.

<sup>1</sup>See p. 14 for an explanation of the load table icons.

# Gas- and Powder-Actuated Fasteners Design Information – Steel

## Powder-Actuated and Gas-Actuated Fasteners — Allowable Shear Loads in Steel<sup>1</sup>



Direct Fastening Type	Model No.	Shank Diameter <sup>10</sup> in. (mm)	Minimum Edge Distance in. (mm)	Minimum Spacing in. (mm)	Minimum Steel Strength <sup>3</sup> ASTM	Allowable Shear Load — lb. (kN)					
						Steel Thickness					
						1/8"	3/16"	1/4"	3/8"	1/2"	3/4"
Powder Actuated	PDPA, PDPAT, PDPAWL	0.157 (4.0)	1/2 (13)	1 (25)	A36	—	410 (1.82)	365 (1.62)	385 <sup>7</sup> (1.71)	385 <sup>7</sup> (1.71)	325 <sup>4</sup> (1.45)
					A572 Gr. 50 or A992	—	420 (1.87)	365 (1.62)	290 <sup>7</sup> (1.29)	275 <sup>7</sup> (1.22)	275 <sup>7</sup> (1.22)
	PINW, PINWP	0.145 (3.7)	1/2 (13)	1 (25)	A36	—	395 (1.76)	—	—	—	—
					PSLV3 Smooth shank	—	770 (3.43)	1,120 (4.98)	—	—	—
PSLV3-12575K Knurled shank	0.205 (5.2)	1 (25)	1 1/2 (38)	A36	—	930 (4.14)	1,130 (5.03)	—	—	—	
				—	—	—	—	—	—		
Gas Actuated	GDP	0.106 (2.7)	1/2 (13)	1 (25)	A36	285 (1.27)	225 (1.00)	205 (0.91)	—	—	—
			1/2 (13)	1 (25)	A572 Gr. 50 or A992	—	250 (1.11)	145 (0.64)	—	—	—
	GDPS	0.118/0.102 (3.0/2.6)	1/2 (13)	1 (25)	A36	—	180 (0.80)	265 (1.18)	225 <sup>8</sup> (1.00)	225 <sup>8</sup> (1.00)	—
			1/2 (13)	1 (25)	A572 Gr. 50 or A992	—	205 (0.91)	305 (1.36)	205 <sup>8</sup> (0.91)	—	—
	GW-50	0.128/0.110 (3.3/2.8)	1/2 (13)	1 (25)	A36	—	400 (1.78)	345 (1.53)	310 <sup>9</sup> (1.38)	—	—
			1/2 (13)	1 (25)	A572 Gr. 50 or A992	—	380 (1.69)	325 <sup>9</sup> (1.45)	350 <sup>9</sup> (1.56)	—	—


- The entire pointed portion of the fastener must penetrate through the steel to obtain the tabulated values, unless otherwise indicated.
- The allowable shear values are for the fastener only. Members connected to the steel must be investigated separately in accordance with accepted design criteria.
- Steel strength must comply with the minimum requirements of ASTM A 36 ( $F_y = 36$  ksi,  $F_u = 58$  ksi), ASTM A 572, Grade 50 ( $F_y = 50$  ksi,  $F_u = 65$  ksi), or ASTM A992 ( $F_y = 50$  ksi,  $F_u = 65$  ksi).
- Based upon minimum penetration depth of 0.46" (11.7 mm).
- Based upon minimum penetration depth of 0.58" (14.7 mm).
- Based upon minimum penetration depth of 0.36" (9.1 mm).
- The fastener must be driven to where the point of the fastener penetrates through the steel.
- Based upon minimum penetration depth of 0.35" (8.9 mm).
- Based upon minimum penetration depth of 0.25" (6.4 mm).
- For stepped shank fasteners: (Diameter of shank above the step)/(Diameter of shank below the step)
- The allowable load values listed are for static load conditions. Refer to ICC-ES ESR-2138 and ESR-2811 code reports for seismic load conditions.

## Spiral Knurl Pin Allowable Tension and Shear Loads in Cold-Formed Steel Studs



Model No.	Shank Diameter in. (mm)	Minimum Edge Dist. in. (mm)	Minimum Spacing in. (mm)	Designation Thickness mil (gauge)	Allowable Loads	
					Tension lb. (kN)	Shear lb. (kN)
GDPSK-138	0.106 (2.8)	13/16 (2.1)	4 (102)	33 (20)	30 (0.13)	70 (0.31)
				43 (18)	48 (0.21)	89 (0.40)
				54 (16)	92 (0.41)	150 (0.67)
				68 (14)	73 (0.32)	218 (0.97)

- Entire pointed portion of the fastener must penetrate through the cold-formed steel to obtain tabulated values.
- The allowable tension and shear values are for the fastener only. Members connected to the cold-formed steel must be investigated separately in accordance with accepted design criteria.
- Fastener is to be installed in the center of the stud flange.
- Loads are based on cold-formed steel members with a minimum yield strength,  $F_y = 33$  ksi and tensile strength,  $F_u = 45$  ksi for 33 mil (20 ga.) and 43 mil (18 ga.), and minimum yield strength,  $F_y = 50$  ksi and tensile strength,  $F_u = 65$  ksi for 54 mil (16 ga.) and 68 mil (14 ga.)

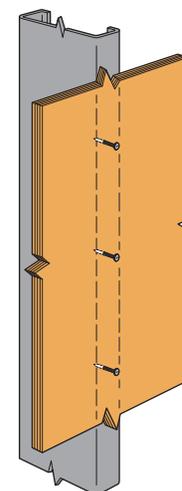

Typical GDPSK Installation

\*See p. 14 for an explanation of the load table icons.